



Energy research Centre of the Netherlands

# Flow-based market coupling: Stepping stone towards nodal pricing?

Adriaan van der Welle

BAEE-CIGRE workshop, The Hague, 26 April 2012



## Outline

- Introduction
- FBMC advantages
- FBMC disadvantages
- Nodal pricing advantages
- Nodal pricing (potential) disadvantages
- Conclusions

## Introduction

### Background


- EC Competition Energy Sector Inquiry (2007): main causes for the lack of competition across EU electricity markets include inefficient use of existing network capacity
- Congestion management important given barriers for network reinforcements

### Starting point of analysis:

- Maximise social welfare
- Trade-off between efficiency/social welfare and equity is left to politicians (EU and national)

## FBMC advantages over NTC/ATC method

- More efficient network utilization due to simultaneous network capacity calculation and allocation
- Higher security of supply due to explicit instead of implicit consideration of parallel flows
- More transparency on network constraints

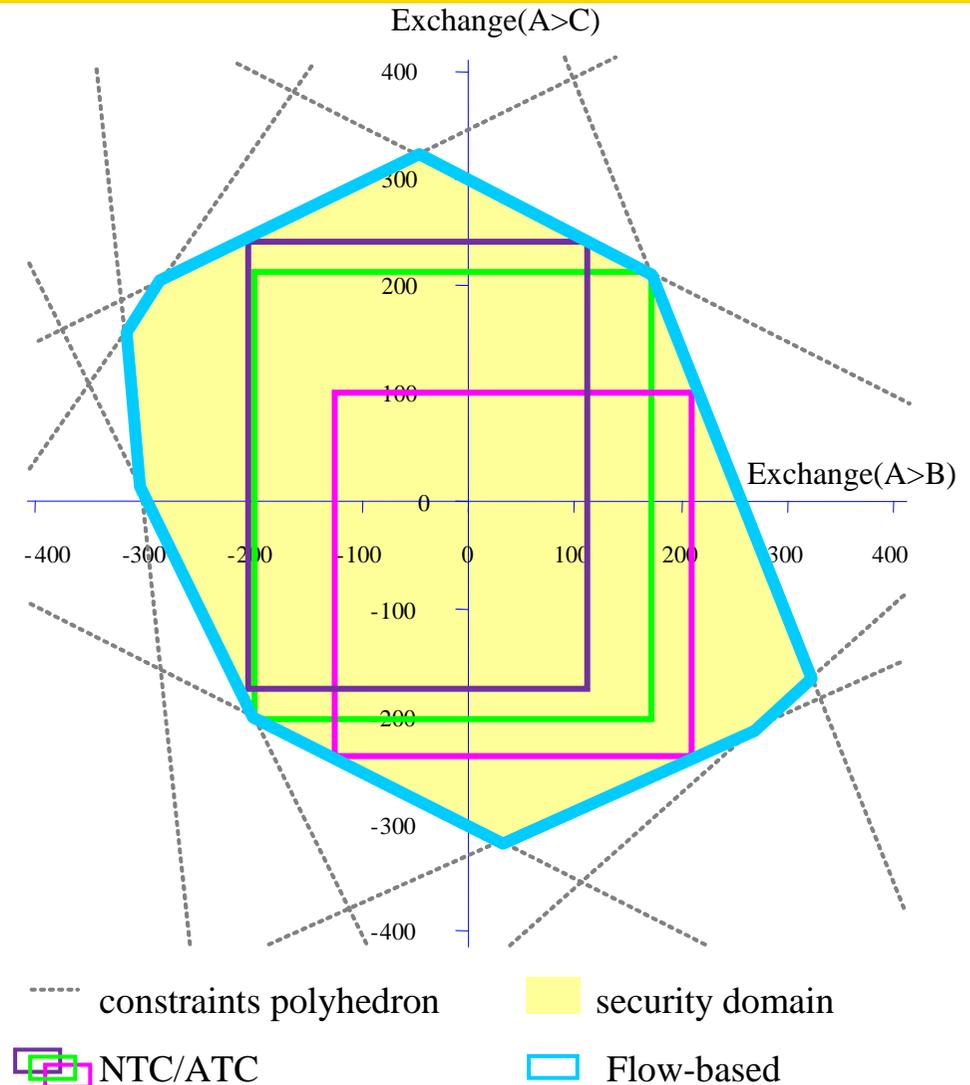

Source: CWE MC Flow-Based Forum July 2011

## FBMC disadvantages w.r.t. nodal pricing

Important hurdles for efficient congestion management remain:

1. Discrimination of intra-zonal transactions compared to inter-zonal transactions
2. Increasing intra-zonal congestion costs
3. Lengthy and time-intensive renegotiations of periodic zone adjustments
4. Incomplete network representation limits trading capacity

# 1. Implicit priority for intra-zonal transactions to inter-zonal transactions (1)


- Power Transfer Distribution Functions (PTDFs) are determined for all critical branches
- NE = net export position for each bidding area (positive = export, negative = import)
- RAM = remaining available margin for day-ahead flows
- For each time step, for each critical branch  $PTDF * NE$  needs to be smaller than or equal to RAM

$$\begin{bmatrix} PTDF \\ matrix \end{bmatrix} \cdot \begin{bmatrix} NE_{BE} \\ NE_{DE} \\ NE_{FR} \\ NE_{NL} \end{bmatrix} \leq \begin{bmatrix} RAM_1 \\ RAM_2 \\ \vdots \\ RAM_p \end{bmatrix}$$

Source: CWE Enhanced FBMC feasibility report

# 1. Implicit priority for intra-zonal transactions to inter-zonal transactions (2)

- Critical branches include intra-zonal lines that are critical to cross-border exchanges
- Net position limited to XB connections → All intra-zonal transactions are both not priced and allowed as long as no intra-zonal congestion occurs
- Intra-zonal transactions can reduce size of the security of supply domain (=FB domain) through PTDFs

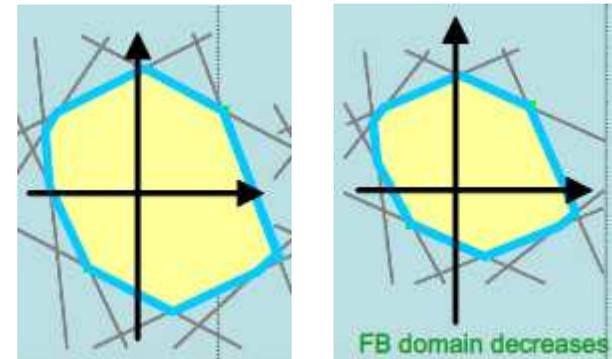

Source figures: CWE Enhanced FBMC feasibility report

- Inter-zonal transactions with lowest contribution to social welfare are deleted by optimization algorithm when congestion occurs  
→ Intra-zonal transactions are preferred to inter-zonal transactions

## 2. Increasing intra-zonal congestion costs (1)

- Deployment of less efficient intra-zonal congestion management market clearing methods like redispatching and countertrading
- Disadvantages of methods based upon redispatching and countertrading
  - Usually socialisation of costs to consumers i.e. no incentive for producers to take into account their contribution to congestion costs in production decisions
  - Gaming (“inc-dec” game) possible
  - Reservation of flexibility (power generation and demand response) for congestion management beforehand → flexibility not available for wholesale market (even when more efficient)

## 2. Increasing intra-zonal congestion costs (2)

- “Intermediate, zonal representations are able to solve part of the congestion management issue, but typically then focus market participants on exploiting intra-zonal congestion ...”, Baldick et al.

	Year	2006	2007	2008	2009
ERCOT	Intra-zonal congestion costs	\$190m	\$169m	\$191m	\$179m
	Inter-zonal congestion rent	\$60m	\$60m	\$400m	\$130m

	Year	2006	2007	2008
California	Intra-zonal congestion costs	\$207m	\$96m	\$174m
	Inter-zonal congestion rent	\$56m	\$85m	\$176m

Source: Baldick et al. (2011), Optimal Charging Arrangements for Energy Transmission: Final Report


- ERCOT and California zonal markets before introduction of nodal pricing showed intra-zonal congestion costs which are often higher than inter-zonal congestion rent
- Note that congestion rents i.e. difference between total market cost and generation costs are typically (much) higher than congestion costs i.e. additional fuel cost for redispatching

### 3. Lengthy and time-intensive renegotiations of periodic zone adjustments (1)

- Bidding zones need to reflect actual congestion pattern to highest extent possible for efficiency reasons
- More frequent changing congestion patterns due to increase of intermittent RES-E
- Adaptation of bidding zones not trivial
  - Large consequences for producers located nearby zone borders
    - Hence, only adaptation foreseen in case of **structural** congestion


# Bidding zones in case of no wind

No wind

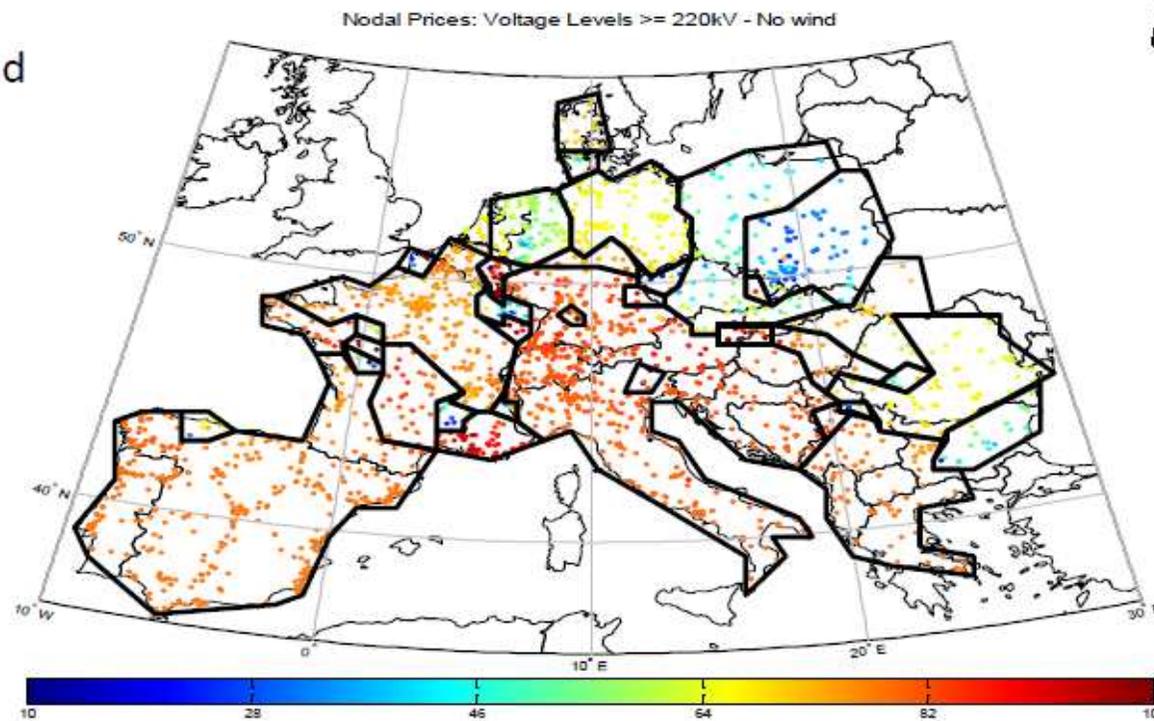

IEE Reshaping project, presentation Neuhoff

# Bidding zones in case of max wind

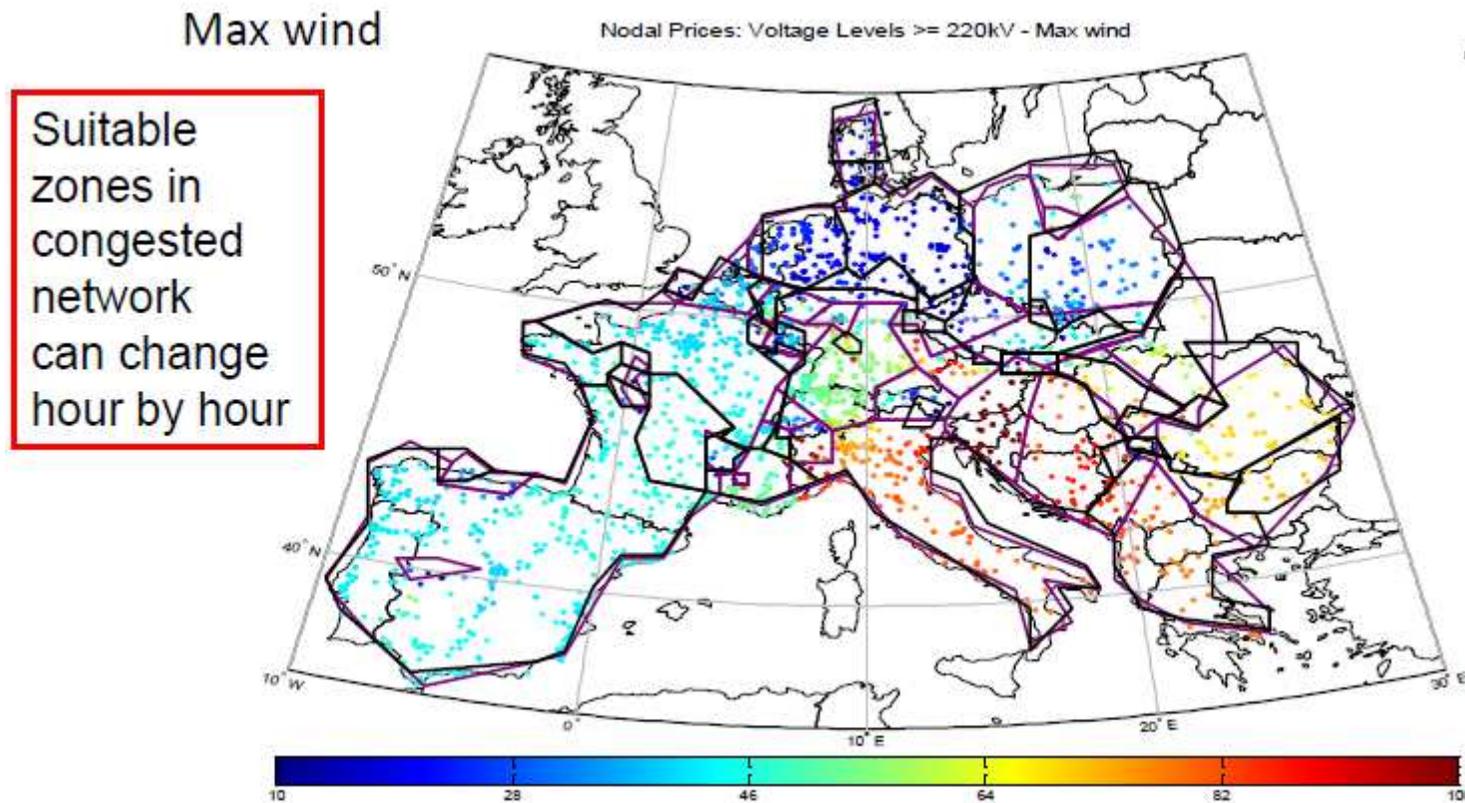


IEE Reshaping project, presentation Neuhoff

### 3. Lengthy and time-intensive renegotiations of periodic zone adjustments (2)

- Definition of structural congestion in Article 2 of draft ENTSO-E CACM network code: congestion in the grid that a.o.
    - is stable over time, i.e. does not change its geographic position in the network under short term influences; and
    - is frequently reoccurring under common circumstances
  - Article 35: biennial evaluation of bidding zone delineation foreseen
  - EU&US lessons: long, time-consuming legal procedures to prevent adaptations of bidding zones; Svenska Kraftnat case, Miguel constraint
  - Several US markets switched from zonal to nodal pricing (PJM, ERCOT, CAISO)
- Very unlikely that bidding zone delineation can follow actual congestion patterns in time in Europe

## 4. Incomplete network representation limits trading capacity

- PTDFs dependent on production forecasts
- PTDFs zonal wide instead of nodal  
→ Generation Shift Keys (GSKs) for identification of impacts on critical branches
- GSKs ex-ante should match with GSKs based upon market clearing results
- Differences between both sets of GSKs due to changes in generation or demand restrict trading capacity

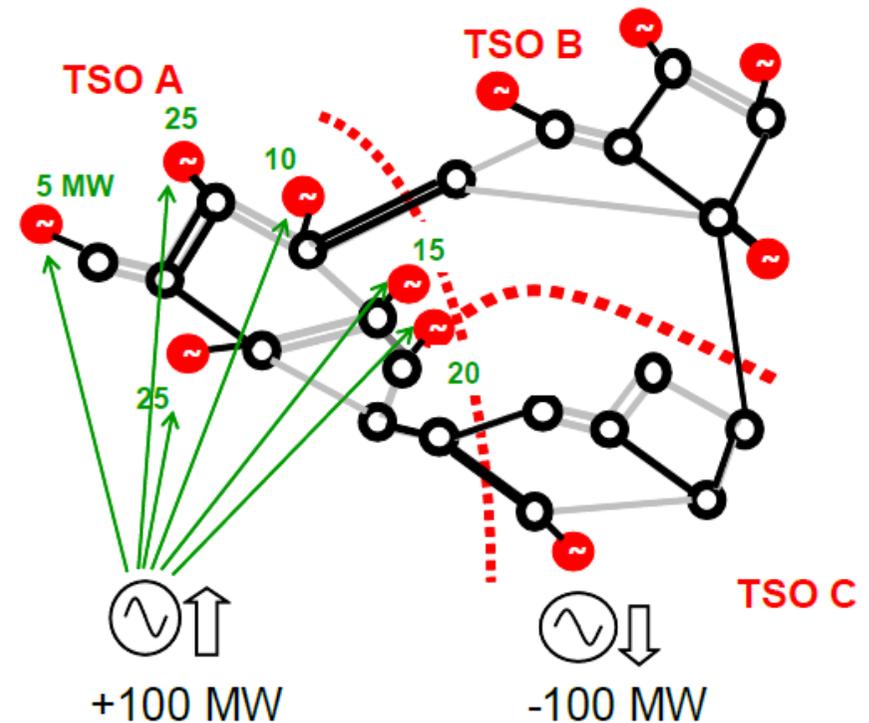

Source: CWE Enhanced FBMC feasibility report

## Nodal pricing as alternative – advantages

- Nodal pricing: bids to buy and sell power are matched for each node in the network for each time interval, taking into account network constraints and losses
  - locational marginal price = cost of energy + cost of delivery
- Considered as first-best solution from market efficiency point of view
- Nodal pricing advantages compared to zonal pricing:
  - No discrimination of inter-zonal and intra-zonal transactions
  - More efficient treatment of intra-zonal congestion
  - Higher network granularity renders periodic zone adjustments redundant
  - Better network representation increases trading capacity

## Potential disadvantages (1) - Market design issues including market liquidity

- a. Nodal pricing more prone to market power than zonal pricing?  
Latter shifts market power within zones to congestion management
- b. Higher liquidity risk of nodes compared to zones/hubs
  - Market places seem liquid however
  - Financial transmission rights (FTRs) allow for hedging of locational price differences
- c. Less possibilities for self-dispatch of generators with nodal pricing?  
Fixed schedule bids possible with adjustment bids for price arbitrage
- d. Nodal pricing requires more centralised market clearing governance solution compared to market coupling  
→ less autonomy for national TSOs and PXs likely

## Potential disadvantages (2) - Distributional effects

- Higher price variability with nodal pricing  
→ more distributive effects compared to zonal pricing
- Price variability within countries lowers political feasibility (e.g. Germany)
- Lower prices for generation located further from load centres and/or producing at times of low demand  
→ Especially disadvantageous for intermittent generation such as wind, although consistent with lower socio-economic value of wind power
- FTR allocation can be used to compensate existing producers which are negatively effected by introduction of nodal pricing

## Conclusions (1)

- FBMC advantages compared to NTC method:
    - More efficient network utilization
    - Higher security of supply due to explicit instead of implicit consideration of parallel flows
    - More transparency on network constraints
  - FBMC disadvantages compared to nodal pricing:
    - Discrimination of intra-zonal transactions compared to inter-zonal transactions
    - Increasing intra-zonal congestion costs
    - Lengthy and time-intensive renegotiations of periodic zone adjustments
    - Incomplete network representation induces lower trading capacity
- FBMC is important step but important hurdles for efficient congestion management in decarbonised power system remain

## Conclusions (2)

- Nodal pricing advantages compared to zonal pricing:
    - Equal level playing field for inter-zonal and intra-zonal transactions
    - Lower average energy prices due to more efficient CM within zones
    - No policy interventions required for zone adjustments
    - Better network representation increases trading capacity
  - Nodal pricing disadvantages:
    - Despite FTRs market participants face probably higher liquidity risk
    - Nodal pricing requires more centralised market clearing governance solution
    - Stronger distributional effects require more mitigation measures at start
- Clear advantages of nodal pricing warrant further development of FBMC towards nodal pricing

# Thank you for your attention!

In case of queries please contact:

[vanderwelle@ecn.nl](mailto:vanderwelle@ecn.nl)